


For outdoor installations run condensate drain from duct furnace into building (See Figure 2)

Figure 2 - Condensate Drain Piping

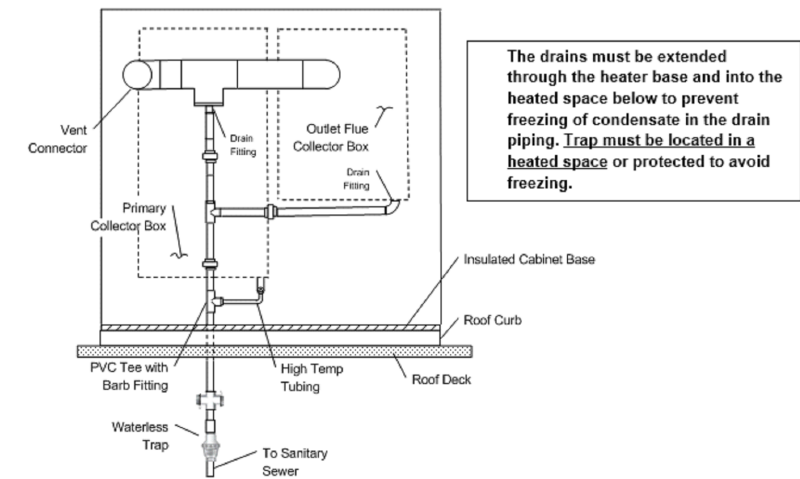

PROPRIETARY AND CONFIDENTIAL
 THE INFORMATION CONTAINED IN THIS DRAWING IS THE SOLE PROPERTY OF HEATCO INC. ANY REPRODUCTION IN PART OR AS A WHOLE WITHOUT THE WRITTEN PERMISSION OF HEATCO IS PROHIBITED.

| | | | | | | |
|-------------|---------|---|--|-----------|---------------|---|
| | | UNLESS OTHERWISE SPECIFIED: | | NAME | DATE | HEATCO 50 Heatco Ct. Cartersville Ga 30120 1-800-554-1007 |
| | | DIMENSIONS ARE IN INCHES TOLERANCES: FRACTIONAL ± ANGULAR: MACH ± BEND ± TWO PLACE DECIMAL ± THREE PLACE DECIMAL ± | | DRAWN | MReese 9-6-16 | |
| | | INTERPRET GEOMETRIC TOLERANCING PER: | | CHECKED | | TITLE: |
| | | MATERIAL | | ENG APPR. | | EF1000-B-V4-SF |
| | | FINISH | | MFG APPR. | | |
| NEXT ASSY | USED ON | | | Q.A. | | SIZE DWG. NO. REV |
| APPLICATION | | DO NOT SCALE DRAWING | | COMMENTS: | | B |
| | | | | | | SCALE: 1:32 WEIGHT: SHEET 1 OF 1 |