

PVC Drain Through Floor of Vestibule (See Detail Below)

Fresh Air Opening

C

B

A

AIRFLOW

12" Exhaust Outlet

2" NPT Gas Connection

Removable Forklift Channels

Weatherproof Extents

AIRFLOW

Weatherproof Vestibule

75.50

D


C

B

A

For outdoor installations run condensate drain from duct furnace into building (See Figure 2)

Figure 2 - Condensate Drain Piping

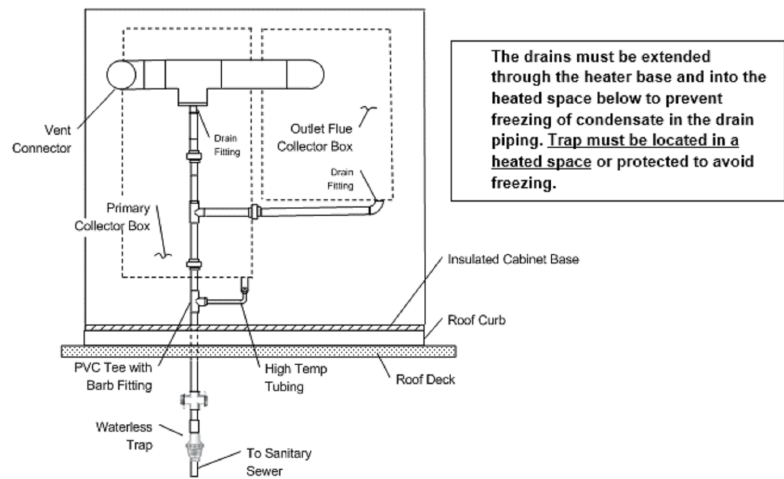

The drains must be extended through the heater base and into the heated space below to prevent freezing of condensate in the drain piping. Trap must be located in a heated space or protected to avoid freezing.

**PROPRIETARY AND CONFIDENTIAL**

THE INFORMATION CONTAINED IN THIS DRAWING IS THE SOLE PROPERTY OF HEATCO INC. ANY REPRODUCTION IN PART OR AS A WHOLE WITHOUT THE WRITTEN PERMISSION OF HEATCO IS PROHIBITED.

		UNLESS OTHERWISE SPECIFIED:		NAME	DATE	<b>HEATCO</b>	50 Heatco Ct. Cartersville Ga 30120 1-800-554-1007	
		DIMENSIONS ARE IN INCHES TOLERANCES: FRACTIONAL ± ANGULAR: MACH ± BEND ± TWO PLACE DECIMAL ± THREE PLACE DECIMAL ±		DRAWN	MReese		8-6-20	TITLE:
		INTERPRET GEOMETRIC TOLERANCING PER:		CHECKED		EF2000-A-V6-SF		
		MATERIAL		ENG APPR.				
NEXT ASSY	USED ON	FINISH		MFG APPR.		<b>B</b>		
APPLICATION		DO NOT SCALE DRAWING		Q.A.		SCALE: 1:32		WEIGHT:
				COMMENTS:		SHEET 1 OF 1		

8

7

6

5

4

3

2

1